


TYPE II

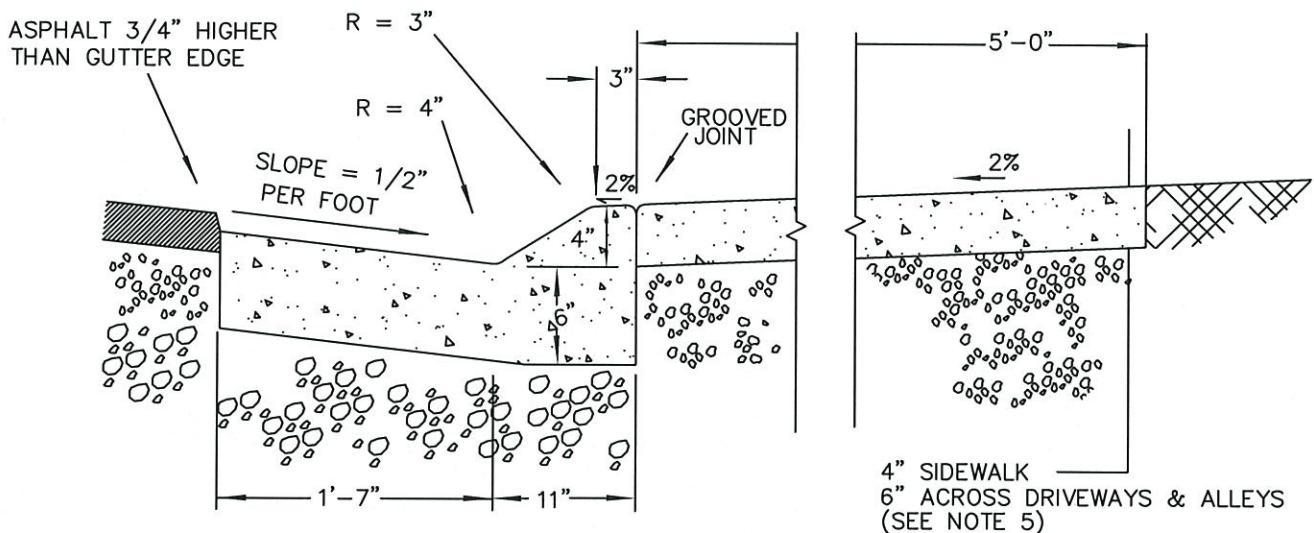

TYPE I

NOTES:

1. SEE APPLICABLE STREET SECTION FOR BASE MATERIAL REQUIREMENTS.
2. CONCRETE SHALL BE A 6 SACK MIX, TYPE II PORTLAND CEMENT, 3/4" MAX. AGGREGATE, 40% CRUSHED LIMESTONE, MIN. 28 DAY STRENGTH OF 4,500 PSI, MAX. 0.45 WATER/CEMENT RATIO, AND 4-1/2" MAX. SLUMP WITH 5-7% AIR ENTRAINMENT.
3. SUBGRADE COMPACTION AND CONTRACTION JOINTS SHALL CONFORM TO SECTION 02528, WPWSS
4. SIDEWALK AND PARKWAY CROSS-SLOPE SHALL BE 2% UP FROM STREET SIDE. TYPE II SIDEWALK WITH PARKWAY SHALL BE 2 TO 2-1/2" ABOVE TOP OF CURB. TOP OF CURB CROSS-SLOPE SHALL MATCH SIDEWALK CROSS-SLOPE.
5. SIDEWALK MAY BE 4" CONCRETE IN RESIDENTIAL DRIVEWAYS, 6" CONCRETE REQUIRED ALL OTHER DRIVEWAYS AND ACROSS ALL ALLEYS (SEE STANDARD NO. 5).
6. TYPE I USED FOR 60' ROW IN RESIDENTIAL AND ALL PUD STREETS. TYPE II USED FOR 60' ROW IN NON-RESIDENTIAL AREAS SHALL HAVE SIDEWALK AGAINST CURB WITH NO PARKWAY.
7. SIDEWALK SHALL BE PLACED SEPARATELY FROM CURB & GUTTER.